
Small Size Switching Power Supply

DIN rail mounting type Switching Power Supply


■ Features

- •Compact size, High quality, Cost-effective
- •Universal input power
- •Able to drive various controllers
- •Built-in overcurrent protection circuit
- •DIN rail mounting and mountable without the rail





Ordering information

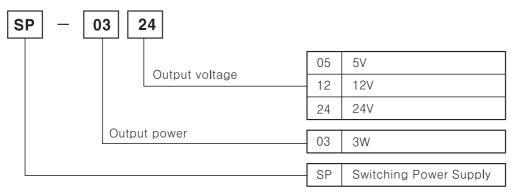

■ Specifications

Model		SP-0305	SP-0312	SP-0324
Capacity		3W		
	Power supply	100-240VAC 50/60Hz		
Input	Frequency	47 ~ 450Hz		
	Current consumption	Max. 0.15A		
	Efficiency	50 ~ 55%	67 ~ 74%	67 ~ 74%
Output	Voltage	5VDC	12 VDC	24VDC
	Allowable voltage range	Max. ±5%		
	Current	0.6A	0.25A	0.13A
	Ripple	Max. 2%		
	Voltage fluctuation ratio	Max. 0.5% (at 85-264VAC 100% Load)		
	Over current protection	Max. 110%		
Series / Parallel operation		Not available		
Output indicator		Led LED		
Insulation resistance		$100 \mathrm{M}\Omega$ min. at 500VDC(Between all inputs and F.G)		
Dielectric strength		2000VAC 50/60Hz for 1 minute		
Vibration resistance		0.75mm amplitude at frequency of 10 to 55Hz in each of X, Y, Z directions for 2 hours		
Shock resistance		300m/s² (30G) in X, Y, Z directions for 3 times		
Ambient temperature		-10 ~ 50°C, Storage: -20 ~ 70°C		
Ambient operating		45 ~ 85%RH		
Unit weight		Approx. 108g		

(A) Counter

(B) Timer

(C) Temp. controller

(D) Power controller

(E) Panel meter

(F) Tacho/ Speed/ Pulse meter

(G) Display unit

(H) Sensor controller

(I) Switching power supply

(J) Proximity sensor

(K) Photo electric sensor

(L) Pressure sensor

(M) Rotary encoder


(N) Stepping motor & Driver & Controller

(O) Graphic panel

(P) Production stoppage models & replacement


Autonics I-2


■Output feature data




<Output feature for the ambient
temperature influence >

- •Please be sure when installing as the efficiency is decreased by ambient temperature.
- •Please refer to output feature beside when installing as the efficiency is affected by mounting status.






Over current protection feature data



•It is able to protect overcurrent by load with built in overcurrent protection circuit. When the over rated current is flowed, the circuit is operated(Output voltage is fallen.) and it is released when the load current is under the rated current.

(It is returned to the rated output voltage.)


■Block diagram

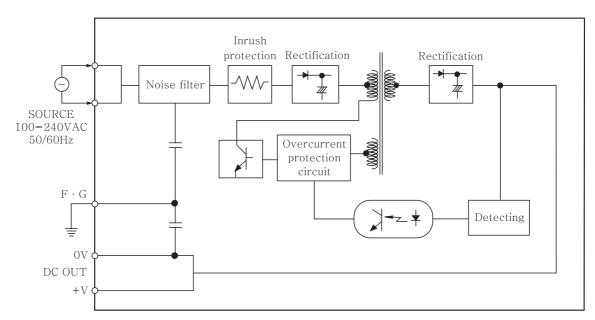


I-3 Autonics


Small Size Switching Power Supply


Dimensions



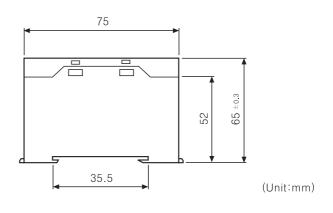

■Front part identification






© SOURCE 100-240VAC 50/60Hz © (85-264VAC)


7 Output indicator-DC output is ON, then LED ON

■Rail mounting method

• To install the power supply on the rail Firstly put the power supply on the part ⓐ of the rail and then press it for the direction ⓑ.




•To remove the power supply from the rail Firstly put a screw driver into the part © and push it downward.



*When mounting the power supply on the rail, please install with a distance of at least 30mm so that the power supply is dismouted easily.

•If there is no rail, it is able to mount by screwing a bolt at the hook on the body as following figure.





(A) Counter

(B) Timer

(C) Temp. controller

(D) Power controller

(E) Panel meter

(F) Tacho/ Speed/ Pulse meter

(G) Display unit

(H) Sensor controller

(I) Switching power supply

(J) Proximity sensor

(K) Photo electric sensor

(L) Pressure sensor

(M) Rotary encoder

(N) Stepping motor & Driver & Controller


(O) Graphic panel

(P) Production stoppage models & replacement

Autonics I-4

■ Proper usage

OSerial and parallel operation

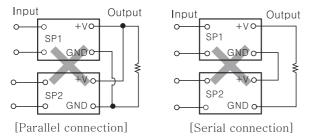


**The power supply shouldn't be used in serial and parallel connection in any case. Please use it individually always.

Caution for mounting

•Please install it at ventilating place in order to dissipate the heat effectively then it is able to improve the reliability for a long time.



 When installing two or more power supplies side by side, please keep the interval at least 10mm so that the heat is dissipated effectively.



OCaution for using

- •Please wire input power(AC) to the input power terminal properly. If wiring it to other terminal the inner circuit will be broken.
- •It is working with 2000VAC between the terminal and case for a minute, but it will be broken if the overvoltage is supplied for several minutes
- •The power supply has 100MΩ of insulation resistance between the terminal and case. Please use D.C insulation tester with 500VDC for the insulation resistance of the power supply.
- •Please check as below when problem is happened.
 - Short of DC output terminal
 (When overcurrent is supplied the overcurrent protection circuit is operated and when the load current is under the rated current it is stopped.)
- 2. Wiring of AC input and DC output terminal properly.
- 3. AC input voltage in rated voltage.

I-5 Autonics